

Simplified LCA - HVACR Electronic Controller

The Functional Unit is to control the temperature of a HVACR application and a 100% of the time for 10 years



216

kg of CO₂eq
Global warming*




3,17E-02

kg of Sbeq
Depletion of abiotic resources*



4.067

MJ
Total use of primary energy*

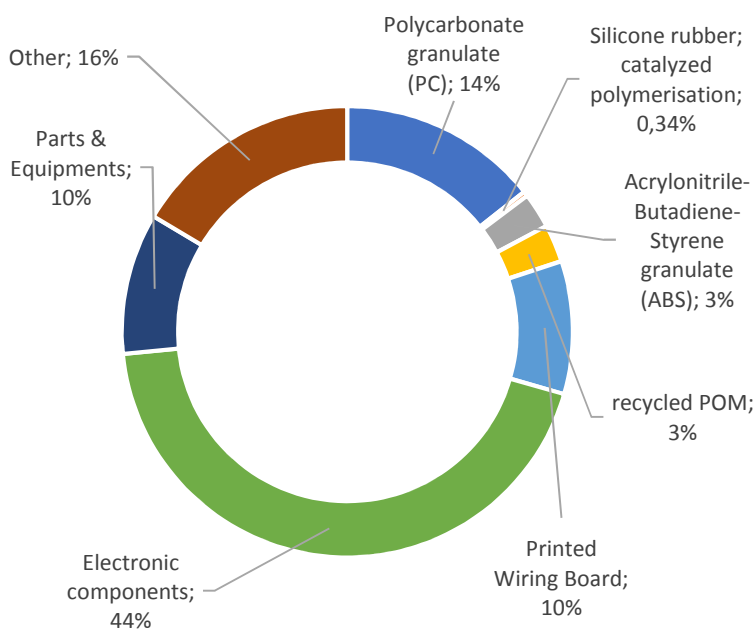

*Results extracted from a simplified life cycle analysis model, aligned with ISO 14040-44 principles - DO NOT COMPLY with ISO 14 025. The results are not comparable with any other assessment